


eThekwini water supply normal



Water works employees.

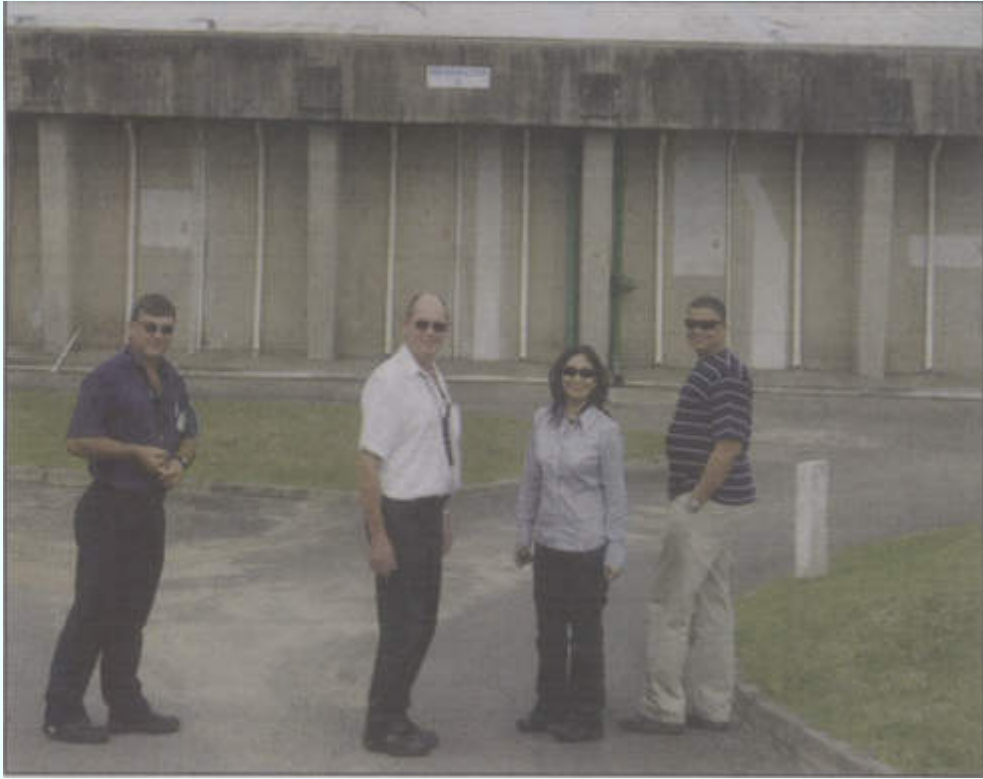

Pictures of the booster pump that was repaired.

The eThekwini Municipality's Water Department is glad to announce that work on the Durban Heights Water Treatment Works booster pump has been completed.

The water supply to the Municipal areas of the North and South/West Durban has been restored fully, days ahead of the stipulated time. The Durban Heights water works was shut down for six days to conduct maintenance, an inspection, and the commissioning of a new booster pump station.

The booster pump station has been designed to augment the supply of water to the Northern areas that are currently experiencing water shortages.

The outlet valve without which the reservoir in question cannot be recommissioned has been successfully replaced.

eThekwini water, Neil Macloed said that the contingency plans, the support of the ratepayers, the excellent work and dedication of the

technical teams involved ensured that no customers were adversely affected by the reduced supply. "The Municipality

appreciates the understanding and co-operation of all the citizens in the areas that were affected by this maintenance project.

The contribution and co-operation of Umgeni Water made this technically complex project a success," said Macloed.

